
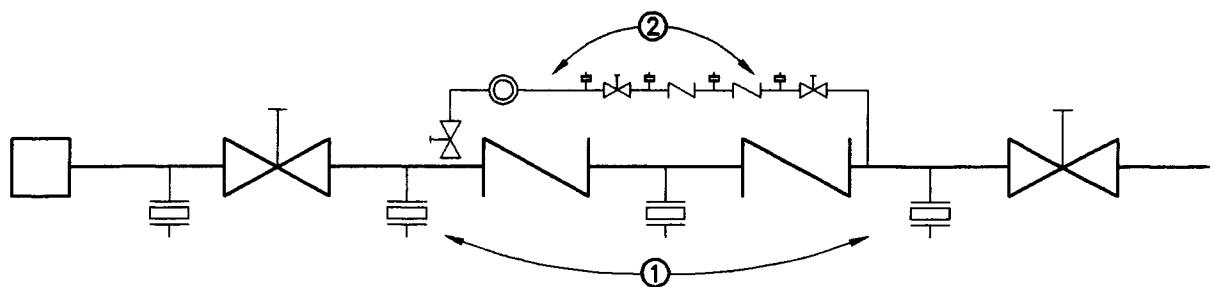


REVISIONS			
DESCRIPTIONS	BY	DATE	APPROVED

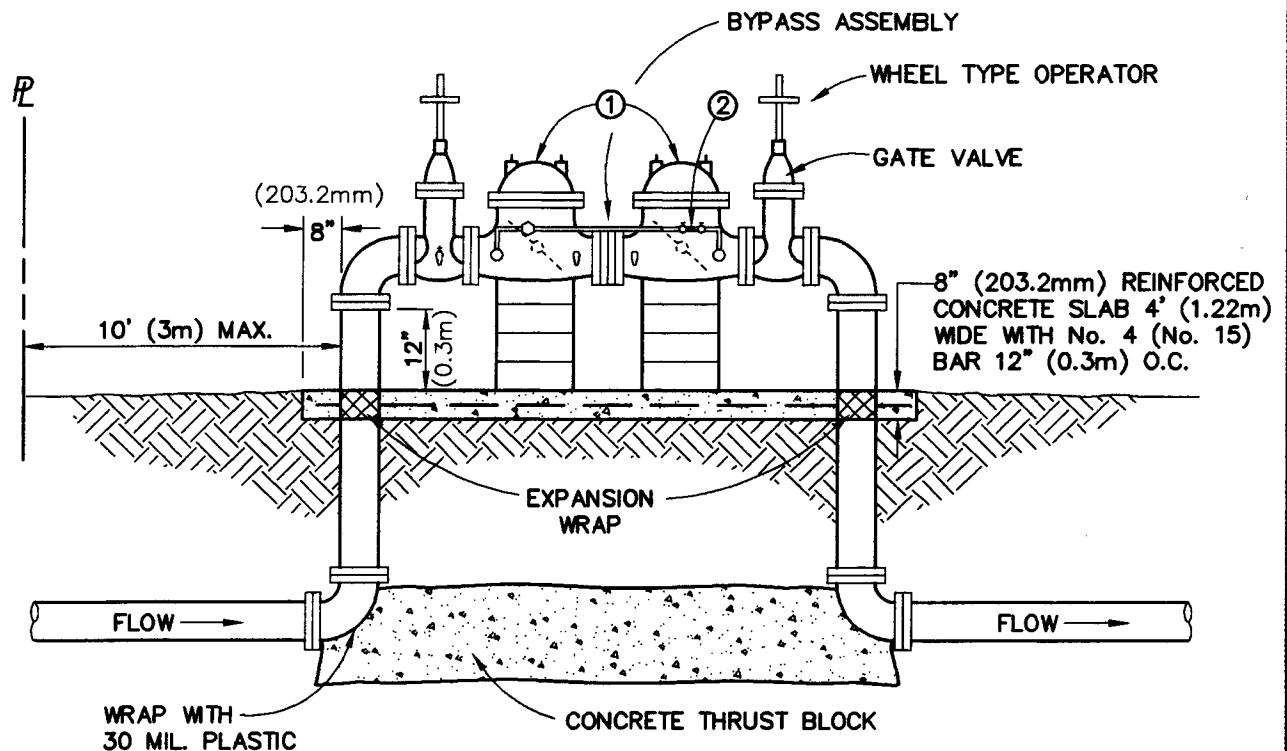

- ① DOUBLE CHECK VALVE ASSEMBLY WITH O.S. & Y. VALVES
- ② BYPASS METER WITH FEBCO 805, WILKINS DCDA 2-1/2" TO 6", OR 950DA 2-1/2" TO 10" DOUBLE CHECK VALVE ASSEMBLY OR APPROVED EQUAL.
- ③ EXPOSED PIPING TO BE INSULATED
- ④ ALL FLANGED FITTINGS WHICH ARE BURIED SHALL HAVE PLASTIC WRAP, 30 MIL
- ⑤ ALL FIRE LINE CONNECTIONS ARE REQUIRED TO HAVE A DETECTOR CHECK, ASSEMBLY FOR A BACKFLOW DEVICE
- ⑥ ALL THREE SIDES MUST BE LANDSCAPED AND SCREENED OR A "WEATHERGUARD BLANKET", OR "LOKBOX", OR APPROVED EQUAL SHALL BE USED IN LIEU OF LANDSCAPING.

DRAWN BY:
C.A.C.
DESIGNED BY:

CITY OF PASO ROBLES
ENGINEERING DIVISION

DRAWING NO.

DATE:
4/18/94
FILE NAME:
PR-G-15.DWG

FIRE LINE SERVICE INSTALLATION

G-15